


ELECTRICAL INSTALLATION

Predrilled holes are provided on the back of the furnace for mounting the fan center electrical box.


The flexible conduit connecting the high limit control to the fan center electrical box has been sized longer for the model 1800. This conduit may be cut shorter to provide a cleaner installation on model 1600.

NOTE: Extra BROWN wire on the Fan Center has no use-cap off or pull out.


**ALL WIRING MUST
BE DONE BY A
QUALIFIED
ELECTRICIAN**

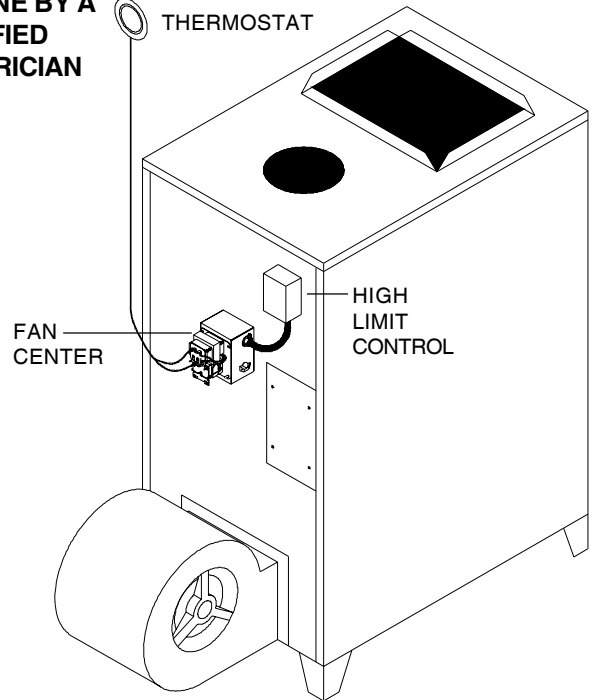



REAR VIEW

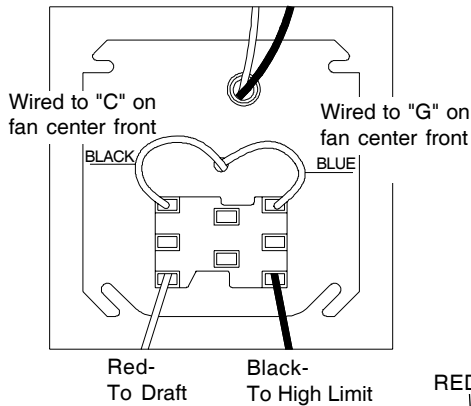

DRAFT WIRING DIAGRAM







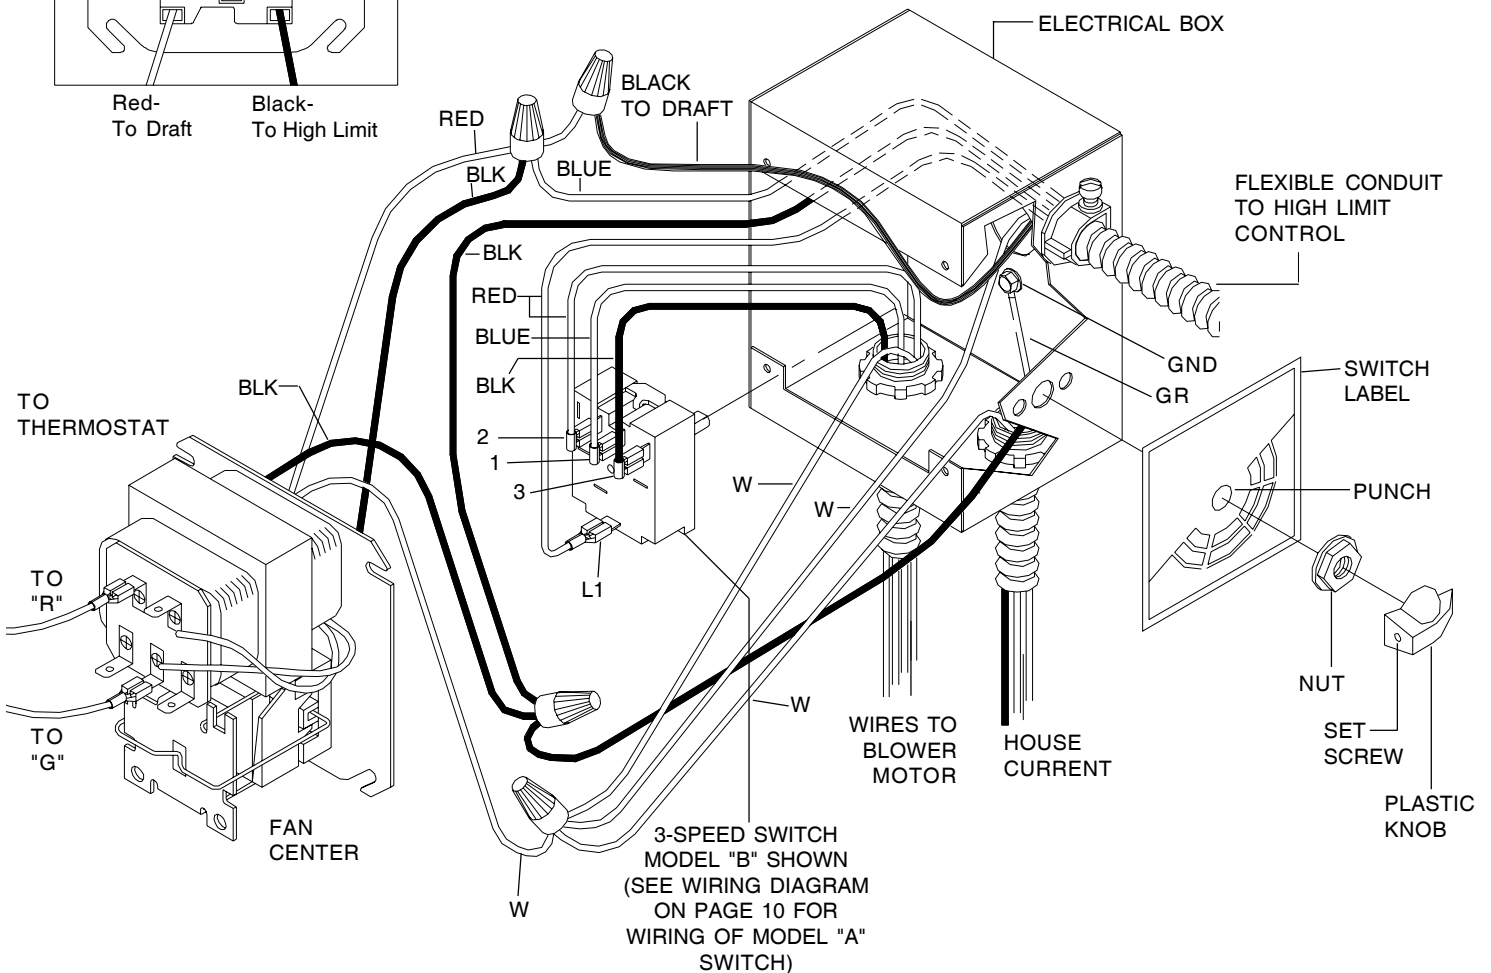


WIRING DIAGRAM

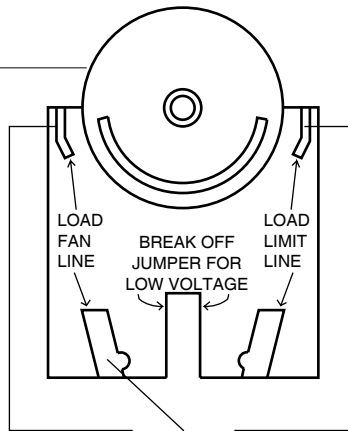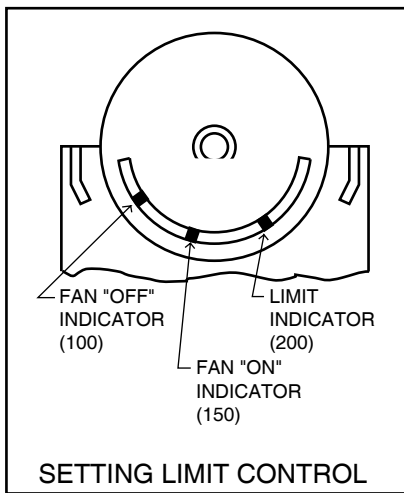

Honeywell
LIMIT SWITCH

WALL THERMOSTAT

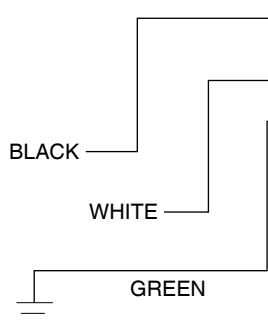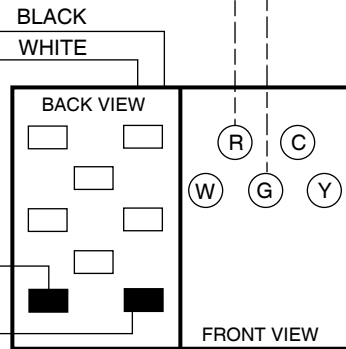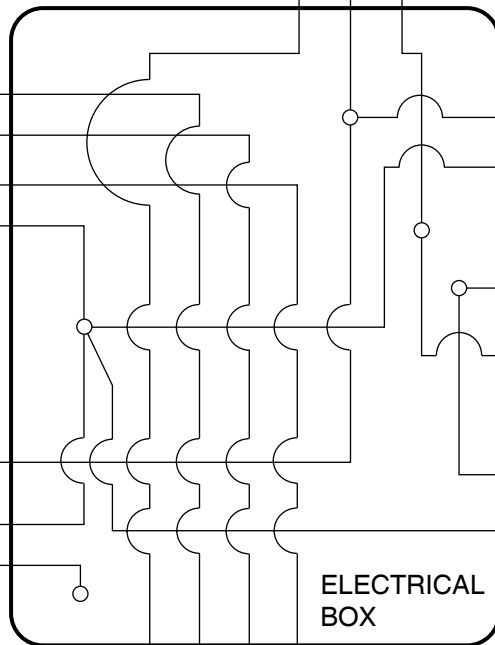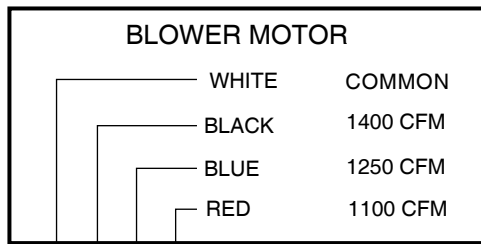

3-SPEED SWITCH
(Two Models are available
Model "A" and Model "B".
Check your switch to see
which model you have
and wire accordingly)

**ALL WIRING MUST BE DONE
BY A QUALIFIED ELECTRICIAN**